

# LANSDALE

## VALVE & MANUFACTURING

www.breccocorp.com

# WAFER CHECK VALVE



UL Listed • FM Approved\*

\*As antiwater hammer check valve for fire pump service only!


250 WOG @ 180° Max

100% Pressure Tested

Approved by New York City Board of Standards &  
Appeals under Calendar No. 157-84-SA.


The 4" size is provided with ½" pipe plug  
in drain port as standard configuration.

\*Contains Lead. Not Intended for Use in Potable  
Water Systems\*

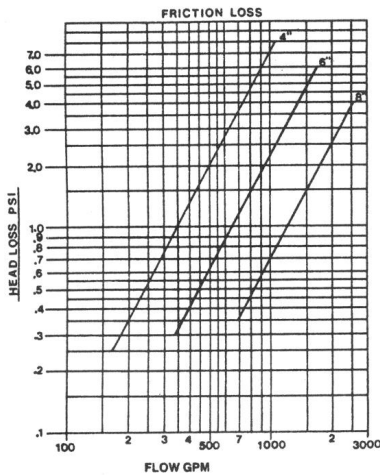

## MATERIAL LIST

NO.	DESCRIPTION	MATERIAL
1	Body	Ductile Iron
2	Seat Ring Assembly	Bronze
3	Screw	Stainless Steel
4	Seat Ring O-Ring	Buna-N
5	Face O- Ring	Buna-N
6	Pipe Plug	Steel

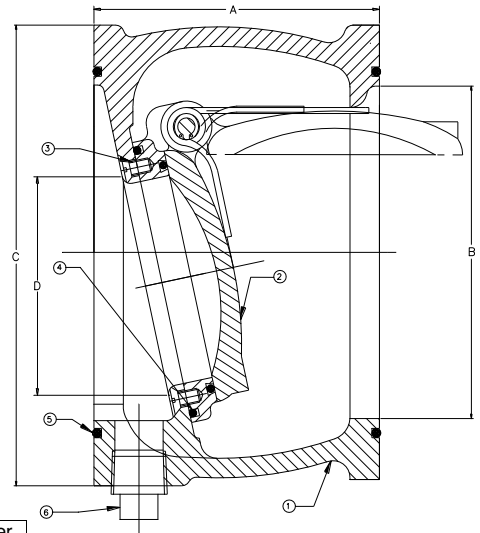

Size	A	B	C	D	Ship Wt. (lbs)	Qty. Per Ctn.
4"	4.25	4.03	6.86	3.00	15.0	1
6"	3.75	6.06	8.50	4.50	19.0	1
8"	3.75	7.98	11.00	6.00	29.0	1

PROJECT INFORMATION		APPROVAL STAMP
Project:		<input type="checkbox"/> Approved
Address:		<input type="checkbox"/> Approved as noted
Contractor:		<input type="checkbox"/> Not approved
Engineer:		Remarks:
Submittal Data:		
Notes 1:		
Notes 2:		